


Model 750-HW-MT-120 Probe Type High Water Manual Reset Control Unit





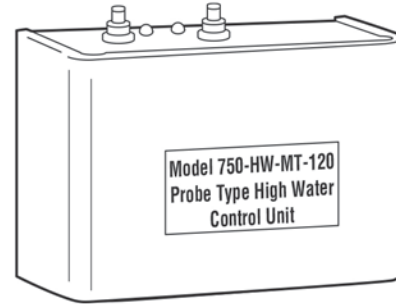


Model 750-HW-MT-120
Control Unit




Applications:
Conductance type control for steam boilers
when a manual reset high water alarm or
cut-off is required.

WARNING

	<ul style="list-style-type: none"> • Before using this product read and understand instructions. • Save these instructions for future reference.
	<ul style="list-style-type: none"> • All work must be performed by qualified personnel trained in the proper application, installation, and maintenance of plumbing, steam, and electrical and/or systems in accordance with all applicable codes and ordinances. • Boiler manufacturer schematics should always be followed. In the event that the boiler manufacturer's schematic does not exist, or is not available from the boiler manufacturer, refer to the schematics provided in this document. • To prevent serious burns, allow the control and surrounding equipment to cool to 80°F (27°C) and allow pressure to release to 0 psi (0 bar) before servicing. • To prevent electrical fire or equipment damage, electrical wiring insulation must have a rating of 167°F (75°C) if the liquid's temperature exceeds (180°F (82°C)).
	<ul style="list-style-type: none"> • This control can be installed in series with all other limit and operating controls installed on the boiler. After installation, check for proper operation of all of the limit and operating controls, before leaving the site. • When using mixed voltages, do not jumper from terminal 1 to terminal 3. • To prevent electrocution, when the electrical power is connected to the flow switch, do not touch the terminals, or electrical wires. • To prevent electrical shock, turn off the electrical power before making electrical connections.
	<ul style="list-style-type: none"> • This product can expose you to chemicals including Lead, which is known to the State of California to cause cancer and birth defects or other reproductive harm. For more information go to: www.P65Warnings.ca.gov. • Previous controls should never be installed on a new system. Always install new controls on a new boiler or system.
	<p>Failure to follow this warning could cause property damage, personal injury or death.</p> <p>CAUTION:</p> <ul style="list-style-type: none"> • A more frequent replacement interval may be necessary based on the condition of the unit at time of inspection. McDonnell & Miller's warranty is one (1) year from date of installation or two (2) years from the date of manufacture.

SPECIFICATIONS

The Model 750-HW-MT-120 control provides continuous protection against a high water condition in steam boilers. It can be used to interrupt the burner circuit to turn off the burner, interrupt the feedwater pump circuit to turn off the pump, or both. The control can also be used to provide an alarm (light, horn or both) when a high water condition occurs. The manual reset function will require that the unit be reset after water has dropped below the level of the probe.

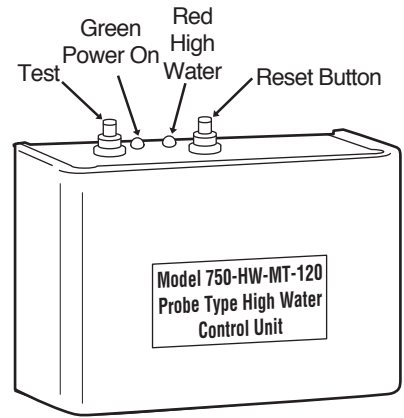

Manual Reset

If a high water condition occurs (water is on the probe), the Burner will turn Off. The Manual Reset button must be pressed to make the control back to function after the water level drops below the probe.

Control Unit

Temperature Ratings:

Storage: -40°F to 135°F (-40°C to 57°C)
 Ambient: 32°F to 120°F (0°C to 49°C)

Humidity: 85% (non-condensing)

Electrical Enclosure Rating: NEMA 1 General Purpose

RS-1-BR1 Remote Sensor

Maximum Steam Pressure: 250 psi (17.6 kg/cm²)

Maximum Water Pressure: 250 psi (17.6 kg/cm²)

Maximum Water Temperature: 406°F (208°C)

Electrical Enclosure Rating: NEMA 4X Watertight, Corrosion Resistant

Connection Size: 1" NPT

RS-1-LP

Maximum Steam Pressure: 15 psi (1.0 kg/cm²)

Maximum Water Pressure: 160 psi (11.2 kg/cm²)

Maximum Water Temperature: 250°F (121°C)

Electrical Enclosure Rating: NEMA 1 General Purpose

Connection Size: 3/4" NPT

Electrical Specifications

Model	Voltage	Motor Switch Rating (Amperes)		Pilot Duty
		Full Load	Locked Rotor	
120 VAC	120 VAC	7.2	43.2	125 VA at 120 or 240 VAC 50 or 60 Hz
	240 VAC	3.6	21.6	

Control Voltage: 120 VAC

Hz: 50/60

Control Power Consumption: 3 VA (max.)

Probe Sensitivity: 20,000 ohm

CSD-1 Code Compliance


On Manual Reset Units, if the control is in high water condition (water reaches the probe) and there is an interruption of electric power, the Burner will remain off even if power is restored. The Reset button must be depressed to make the control back to function after the water level drops below the probe.

STEP 1 - Where to Install the Remote Sensors

Determine where to install the remote sensor (sold separately) based on the following requirements:

Option A

- a. The Remote Sensor can be installed directly in a 1" or larger tapping in the top of the boiler.
- b. The probe of the RS-1-BR-1 Remote Sensor will need to be cut to appropriate length based upon the level where high water cutoff/alarm is desired.
- c. The probe of the RS-1-LP Remote Sensor is approximately 2" long therefore high water cutoff/alarm will occur at that level.
- d. There must be a minimum 1/4" (6.4mm) clearance between the probe and any grounding surface inside the boiler or pipe.

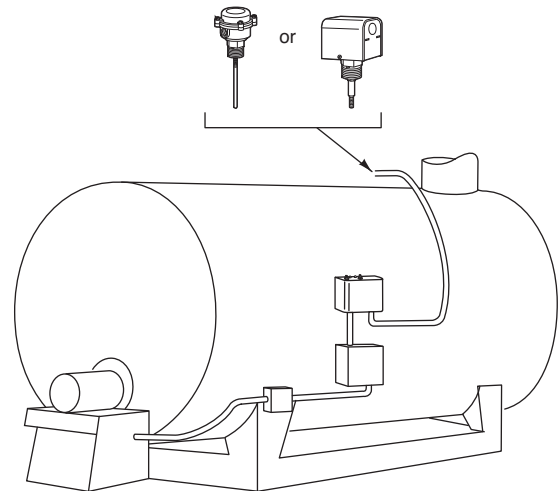


Option B

- a. The Remote Sensor can be installed directly into the 1" fittings of the boiler's equalizing piping.
- b. If installed in the upright or vertical position:
 - The probe of the RS-1-BR-1 Remote Sensor will need to be cut to appropriate length based upon the level where high water cutoff/alarm is desired.
 - The probe of the RS-1-LP Remote Sensor is approximately 2" long therefore high water cutoff/alarm will occur at that level.
- c. If installed in the sideways or horizontal position:
 - The probe of the RS-1-BR-1 Remote Sensor cannot exceed 4" in length.

NOTE: The Remote Sensors **SHOULD NOT** be installed in equalizing piping that is smaller than 1" NPT.

- d. There must be a minimum 1/4" (6.4mm) clearance between the probe and any grounding surface inside the boiler or pipe.

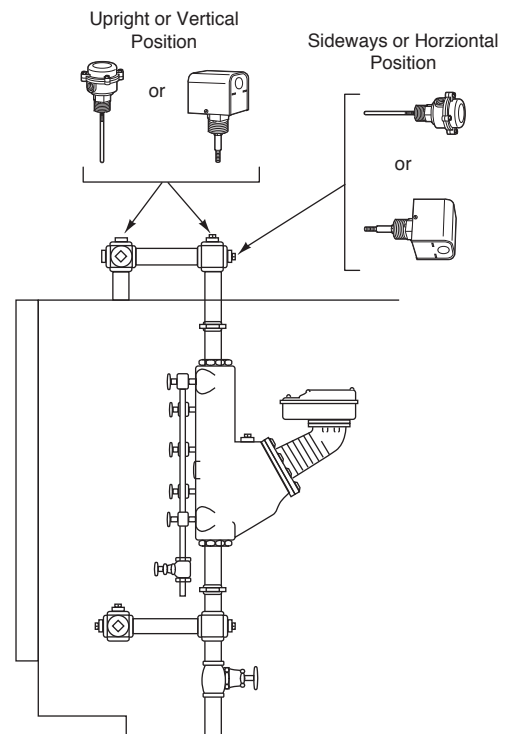

STEP 1 - Where to Install the Remote Sensors

Table 1. Remote Sensors

Catalog No.	Part No.	Sensor Boiler Tapping	Sensor Housing	Sensor Pressure Rating (psig)	Sensor Temp. Rating °F
RS-1-LP	176203	3/4" NPT	NEMA 1	160 (water)/15 (steam)	250°
RS-1-BR-1*	179524	1" NPT	NEMA 4X	250 (water & steam)	406°

* Requires probe extension (See table 2).

Table 2. Stainless Steel Probe Extensions*


Catalog No.	Part No.	Length, Inches
RS-1/3-SS	176208	4-1/2
PS-1-SS	179530	12
G-2-SS	179156	24
G-3-SS	179157	36

* To be used with remote sensor (RS-1-BR-1) mounted in vertical position only.

REMOTE SENSORS

RS-1-LP
(15 psi Steam or
160 Psi Hot Water, Max.)


RS-1-BR-1
(250 Psi Steam or
Hot Water, Max.)

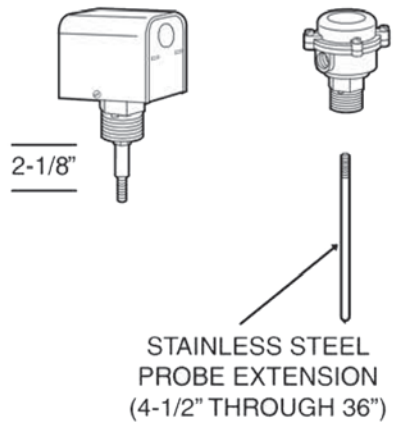

STEP 2 - Installing the Remote Sensor

For the Model RS-1-BR-1 sensors, only:

- a. Cut the probe to desired length. Screw, clockwise, the threaded stainless steel probe extension (A) into the remote sensor (B). Carefully tighten the locking nut to approximately 1 ft·lb (1.7 N·m). Do not cut the clear plastic protective tube.




For All Remote Sensors


- b. Apply a small amount of pipe dope to the first threads (L) of the remote sensor.

WARNING


Do not use PTFE tape. Only use pipe sealant. Failure to follow these instructions will cause the probe not to function as intended and could cause property damage, personal injury or death.

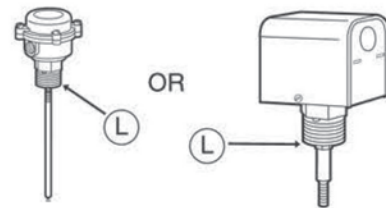

- c. Insert the remote sensor (B) into the boiler tapping (M) as determined in Step 1.

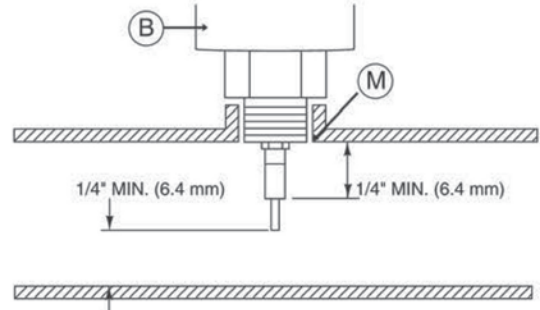


- d. Using the adjustable wrench (N), tighten the brass hex adapter (P) on the remote sensor (B) to approximately 63 ft·lb (85 N·m). DO NOT TIGHTEN BY TURNING THE SENSOR HOUSING.

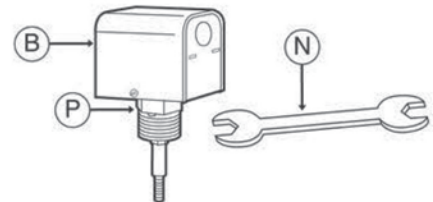

- e. Remove the sensor housing cover (Q).

1. **For Model RS-1-BR-1**, using a flathead screwdriver (R), remove the four (4) screws and separate the housing cover (Q) from the sensor (B).
2. **For Model RS-1-LP**, using a flathead screwdriver or nut driver (R), loosen the two (2) screws and separate the housing cover (Q) from the sensor (B).

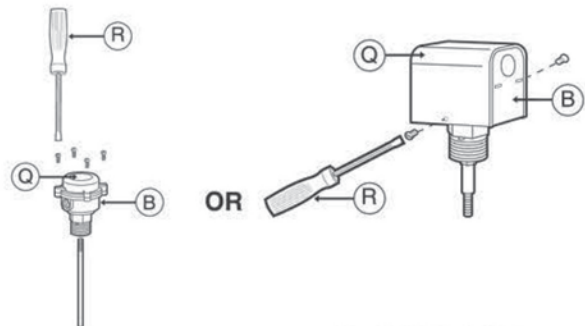


Model RS-1-BR-1


Model RS-1-LP

STEP 3 - Installing the Control Box

Mount **Control Box** in a suitable location near the boiler's main electrical panel.

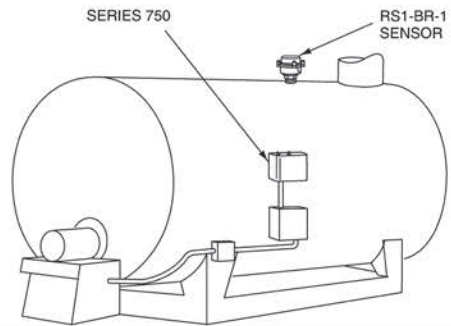


- a. Using the flatblade screwdriver or nut driver (C), loosen the two (2) screws (D) and remove cover (E).

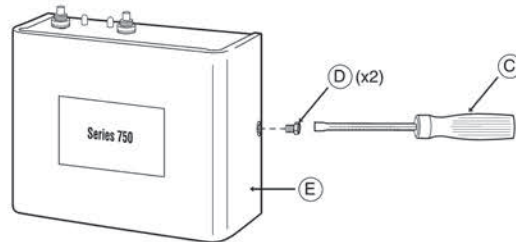

- b. Using the four (4) 3/16" (4.8mm) mounting holes (F), attach the control (G) to the boiler jacket, entry plate, or other suitable location.

NOTE: Mounting hardware is not included.

IMPORTANT: To protect control from damage caused by liquid or debris, mount as shown with buttons on top.

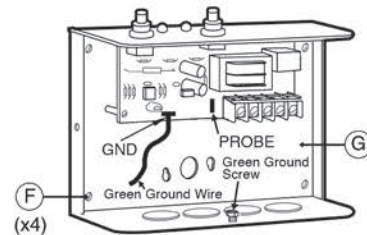


- c. Install an electrical conduit (H) to the conduit knockouts (J). Wire-ways should be able to accommodate the 120VAC supply circuit, the remote probe circuit, alarm feeder circuit and burner circuit.

- d. Connect green wire from ground screw on the controller's metal chassis to Terminal connection "GND" on PCB.

NOTE

Refer to and follow local codes and standards when selecting conduit and electrical fittings. Wires from Probe Housing and Control Box must be in their own conduit. If they are run in conduit with other wires, there may be interference that can affect the performance of the control.

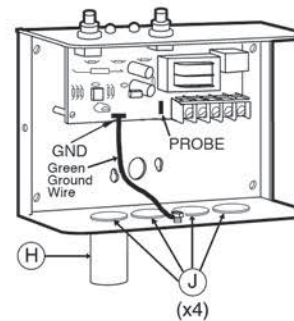


- e. Install electrical conduit between **Probe Housing** and **Control Box**.

NOTE

Wire must be 18 AWG stranded with glass braided silicone jacket (UL 3071) suitable for high temperature (200°C) service.

NOTE: Boiler sight glass must be visible from location of Control Box and must be within 25 feet of Control Body.

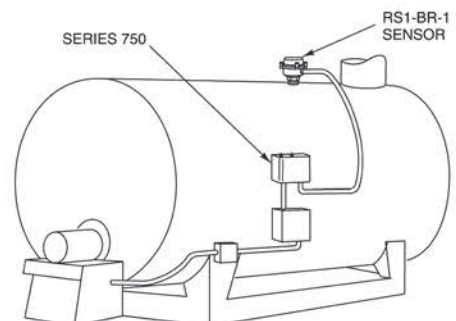

STEP 4 - Electrical Wiring



IMPORTANT

Boiler manufacturer schematics should always be followed. In the event that the boiler manufacturer's schematic does not exist, or is not available from the boiler manufacturer, refer to the schematics provided in this document.




WARNING



To prevent an electrical fire or equipment damage, electrical wiring must have a rating of 167°F (75°C) if the liquid's temperature exceeds 180°F (82°C). Failure to follow this warning could cause property damage, personal injury or death.

- a. For all wire connections to the terminal block (M).
1. Strip about 1/3" (8.5 mm) of insulation from the wire.
 2. Loosen the terminal screw (N), DO NOT REMOVE, and move the wire clamping plate (P) back until the plate touches the back side of the screw head.
 3. Insert the stripped end of the wire under the wire clamping plate (P) and securely tighten the terminal screw (N).



Wiring Diagram Legends


1. Bold lines indicate action to be taken in Step shown.
2. Dotted black lines indicate internal wiring.

b. Remote Sensor Wiring:

- Connect black wire from probe end to Terminal connection "PROBE" on PCB.
- Connect green wire from ground screw on the controller's metal chassis to Terminal connection "GND" on PCB.

Control Wiring:

- Connect 120V hot wire to Terminal 1
- Connect 120V neutral wire to Terminal 2
- Connect jumper wire from Terminal 1 to Terminal 3
- Connect wire from beginning of limit circuit (thermostat, gas valve, limits, etc.) to Terminal 5
- Connect wire from end of limit circuit to Terminal 2

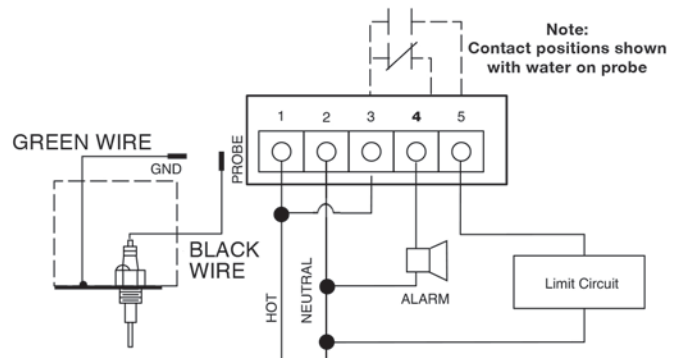


WARNING

- Electrical connections are to be made by a qualified electrician in accordance with all applicable codes, ordinance and good practices.
- The probe wire must be connected to the terminal connection marked with "Probe" from PCB and ground wire must be connected to the terminal connection marked with "GND" from PCB. Failure to follow these instructions could result in property damage, personal injury or death.

c. Secure the sensor housing cover (Q).


1. **For model RS-1-BR-1**, using the flatblade screwdriver (R), tighten the four (4) screws into the housing (Q) to approximately 3 ft•lb (4 N•m).
2. **For model RS-1-LP**, using the flatblade screwdriver or nut driver (R), tighten the two (2) screws into the housing (Q) to approximately 2 ft•lb (2.6 N•m).

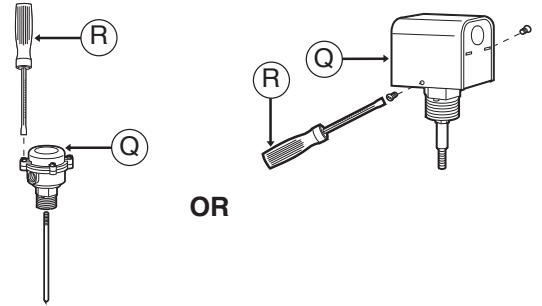

Model RS-1-BR-1

Model RS-1-LP

d. Secure the control housing cover by using the flatblade screwdriver or nut driver (R) to tighten the two (2) screws (D) to approximately 2 ft•lb (2.6 N•m).

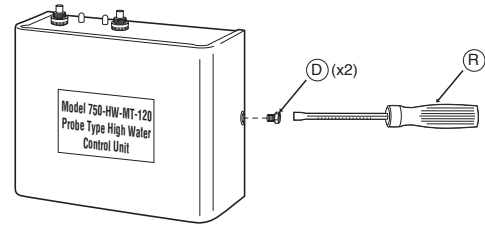

STEP 5 -Testing and Diagnostic Procedures

Start-Up

- a. **Before filling the system**, turn on the electric power to the boiler.
1. Upon initial power up, the Green and Red lights will flash simultaneously 4 times.
 2. The Green light will turn "ON".
 3. The Red light will turn "OFF" and the burner will turn "ON" as long as there is water off the probe.

Manually Testing Control


- b. **Slowly fill the boiler with water.**
1. When water touches the probe, the Green light will remain "ON".
 2. The Red light will turn "ON" and the burner will turn "OFF", when water touches the probe.

Testing Control Using "Test Button"

c. **Depressing test button with "water off probe"**

(Must depress and hold test button to activate test cycle.)

1. When test cycle is activated the Red and Green lights will flash simultaneously twice.
2. The Red light will turn "ON".
3. Burner will turn "OFF".
4. The Green light stays "ON" while the test button is depressed.
(Release test button. You must depress the manual reset button to unlock the high water cut-off.)
5. After depressing manual reset button, the Green and Red lights will flash simultaneously 4 times.
6. Then the Green light will turn "ON" and the Red light will turn "OFF".
7. The burner will turn "ON" if the water is off the probe.

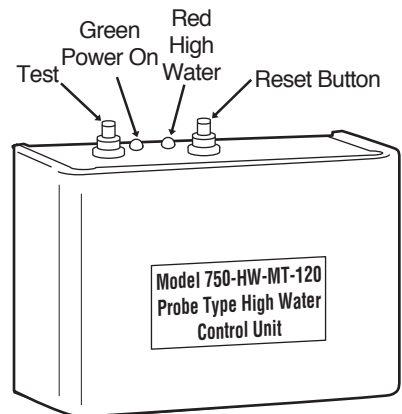

Troubleshooting

If control fails to operate as required, perform the following diagnostic checks:

1. Check to be sure that the water level in the boiler is below the probe.
2. Re-check all wiring to ensure proper connections as specified in boiler manufacturer's wiring diagrams or these instructions.
3. Check to ensure that PTFE tape has not been used on the threaded base of the remote sensor to the boiler.
4. Re-check the electrical ground connection for the remote sensor and control unit.

MAINTENANCE

SCHEDULE:

- **Inspect probe annually or more frequently for scale build-up and clean or replace if necessary.**
Make certain there is no scale or build-up on the probe or its white PTFE insulator. Be careful not to damage the PFA insulator.

WARNING

- **Regular maintenance is required. Failure to follow the device maintenance could result in property damage, personal injury or death.**

CAUTION

Replace Probe if:

- PFA insulator is cracked or worn.
- Probe is loose.

Failure to follow this caution could cause property damage, personal injury or death.

- **Replace probe every 10 years.** More frequent replacement of the probe is required if it is used in locales where significant water treatment is required, or in applications with high make-up water requirements.
- **Replace the control unit every 15 years.**

NOTE

Clean probe by wiping with non-abrasive cloth and rinsing with clean water. **DO NOT** use sharp instruments to remove any accumulations of rust or scale.