

# RMG 790 Water Safety Shut-Off Valve



## PRODUCT INFORMATION

**Serving the Gas Industry  
Worldwide**

## RMG 790 WATER SAFETY SHUT-OFF VALVE


Application, features, technical data

### Application

- for installation in the hot water circuit of gas preheaters for boiler protection

### Features

- easy installation
- operated by energy already available in the system
- low pressure loss
- easy operational testing


TECHNICAL DATA	
Maximum allowable pressure PS	160 bar
Allowable temperature	140°C medium/environment
Nominal width	DN 25, DN 50, DN 80, DN 100, DN 150
Connection type	The device is designed without flanges for mounting between DIN EN flanges to PN 16 and PN 40 or flanges of Class 300 RF, Class 600 RF, Class 900 RF/RTJ* and Class 1500 RF/RTJ* according to ANSI 16.5
Materials	Main valve body      brass Internal parts        brass, stainless steel Sealing rings        fluorocarbon rubber
Optional features	- electrical remote indication of valve position „OFF“ - electromagnetic remote release triggered by power supplied/ power failure (solenoid valve parallel to the control unit)
Function and strength	Based on DIN EN 14382
Explosion protection	The device has no potential sources of ignition and as such is not covered by ATEX 95 (embedded electronic accessories meet the requirements of ATEX)
CE marking in compliance with PED	
DIN-DVGW reg. no.:	DG-4395AT0085

\*RTJ model on request

SETTING RANGES OF THE SSV CONTROL UNIT		
Control unit setpoint spring number	SSV setting range $W_d$ (bar)	Response pressure group AG
1	2.0 ... 2.5	5
2	2.5 ... 3.5	2.5
3	3.5 ... 16.0	2.5

## RMG 790 WATER SAFETY SHUT-OFF VALVE

### Dimensions

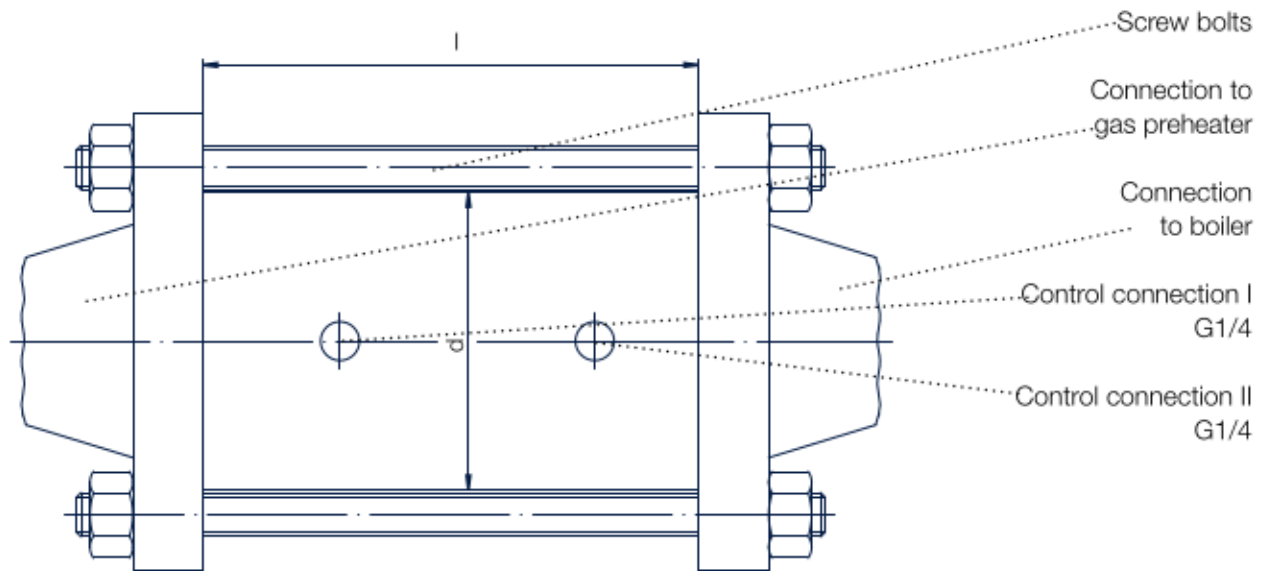

3

DIMENSIONS IN MM					
Pressure rating	Diameter d				
	DN 25	DN 50	DN 80	DN 100	DN 150
PN 10	73	107	142	162	218
PN 16				178	247
PN 25					
PN 40			205	285	
Class 300			**	140	148
Class 600	165	205			285
Class 900	171	205			280
Class 1500*	<b>overall length l</b>				
PN 10 ... Class 600	140	160	160	160	240
Class 900 Class 1500*	**	170	170	180	250

SCREW BOLTS FOR FLANGE CONNECTION		
Pressure rating	Screw bolts	Nuts
PN 10 to PN 40	DIN 2509	DIN EN ISO 4032
Class 300 to Class 1500*	ASTM A 193 size B7	ASTM A 194 size 2H

\*) PS = 160 bar


\*\*) DN 25 in pressure rating > Class 600 on request

Kvs VALUE IN M <sup>3</sup> /H					
	DN 25	DN 50	DN 80	DN 100	DN 150
Feed	10	35	98	134	285
Return	11	40	113	150	310

## RMG 790 WATER SAFETY SHUT-OFF VALVE

### Design and operation


The safety shut-off valve (SSV) RMG 790 is designed for installation in the hot water circuit of gas preheaters feed and return). The device is a connecting unit between the gas preheater (heat exchanger), which is designed for the maximum allowable gas inlet pressure, and the boiler, which has a lower pressure rating. If a defect in the gas preheater (heat exchanger) causes excess gas to flow into the hot water circuit resulting in a pressure increase, the SSV RMG 790 will shut off the boiler from the inlet pressure-resistant heat exchanger as soon as a specified response pressure is reached, regardless of whether the pressure increases very slowly or suddenly. The SSV RMG 790 consists of the main valve and the control unit. The main valve body is flangeless and is mounted between the connecting flange of the heat exchanger and that of the feed/return line to the boiler by means of screw bolts. The valve housing has an axial opening in which the valve area corresponds approximately to the nominal width of the pipe connection. Control connections I and II, which lead into the chambers above and below the valve seat, have been provided for the connection of control pressure gauges and performing operational tests. Under normal operating conditions, all chambers in the safety shut-off device are charged with the boiler pressure prevailing in the hot water circuit of the natural gas preheater. The valve spring keeps the valve plate in the open position. A sealing washer protects the valve plate from the flow force of the circulating hot water, thus preventing it from being inadvertently closed. If the pressure in the hot water circuit increases due to a leak in the heat exchanger, the control unit will open 0.3 to 1 bar before the specified response pressure of the safety shut-off valve is reached, releasing a small amount of water. The pressure limit at which the control unit opens depends on the nominal width and installation position of the SSV RMG 790; Further details are available in the operating and maintenance instructions and spare parts list for RMG 790.20. The control unit maintains more or less constant pressure in the intermediate chamber below the valve pistons, whilst the pressure in the rest of the system above the valve piston continues to rise.

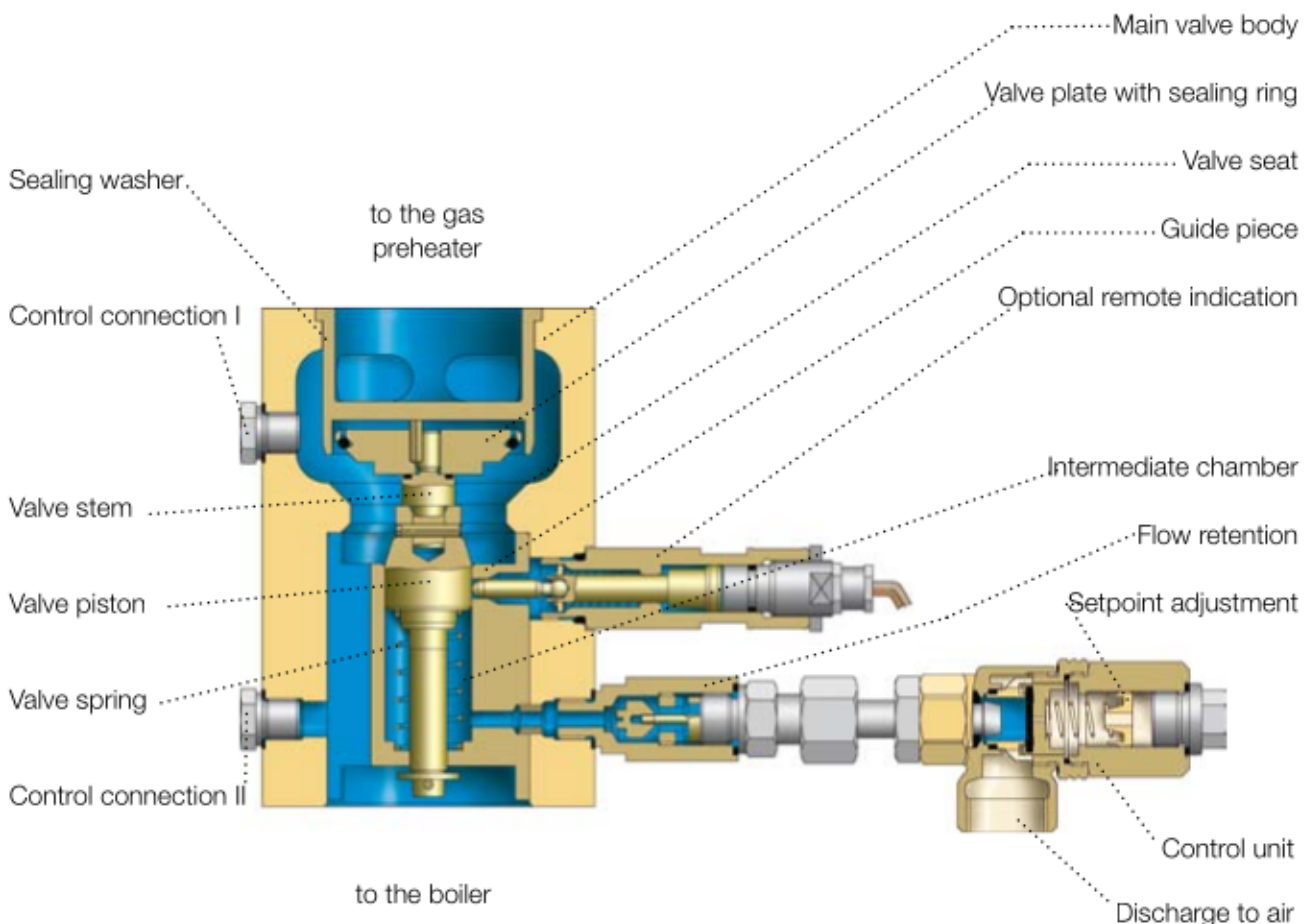

## RMG 790 WATER SAFETY SHUT-OFF VALVE


Design and operation

The SSV closes as soon as the force acting on the valve piston, which is generated by the pressure differential between the upper side of the piston (pressure in a heat exchanger) and the intermediate chamber (pressure controlled by the control unit), exceeds the pretensioning force of the valve spring. The valve plate presses down tightly on the valve seat forming a pressure-resistant seal which shuts off the hot water circuit. Closure of the valve plate is indicated electrically in the version with remote indication.

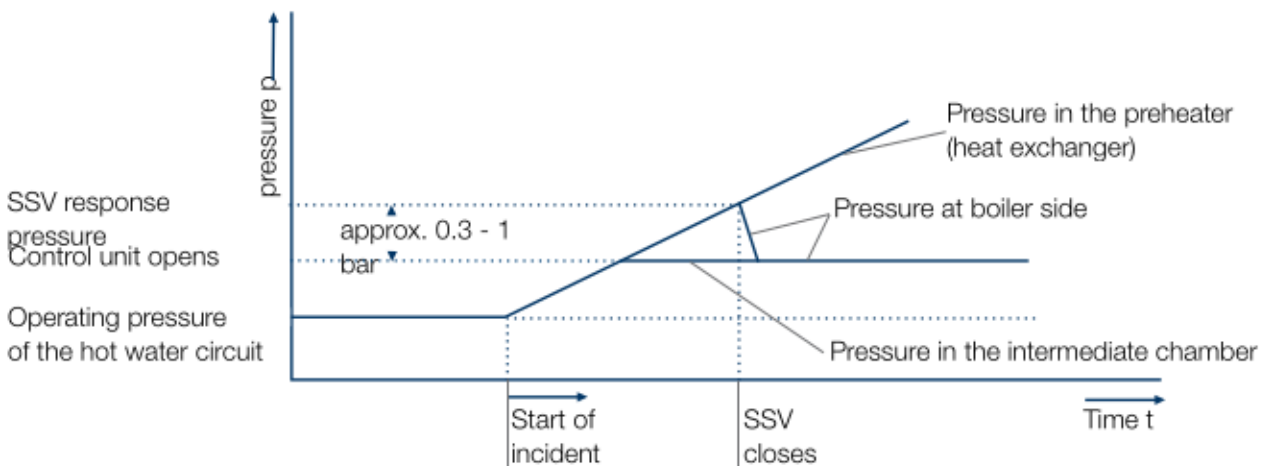

The safety shut-off device (SSV) will open again when the pressure in the heat exchanger (above the valve plate) has fallen to a value below the response pressure of the control unit (SSV response pressure minus 0.3 to 1 bar). The remote indication system is available in two different designs depending on the temperature in the hot water circuit. It cannot be retrofitted.

### Pressure loss depending on the flow rate in the hot water circuit

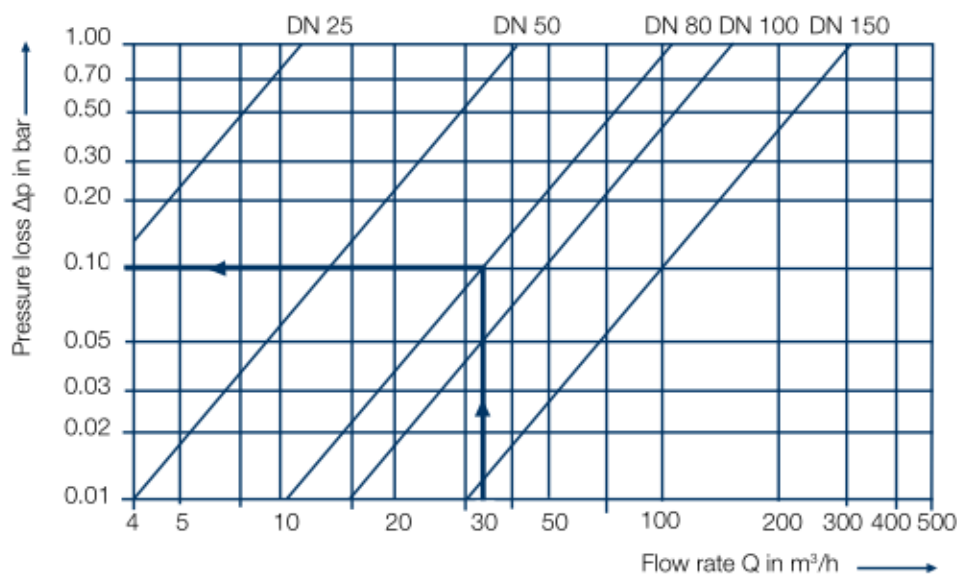

**Example:** nominal width DN 80, flow rate  $Q = 35 \text{ m}^3/\text{h}$  -> pressure loss  $\Delta p = 0.1 \text{ bar}$

**Note:** The pressure loss should not exceed 0.5 bar. The SSV must be installed in the feed and return line. The pressure loss must be factored in twice to calculate the correct pump size.

## RMG 790 WATER SAFETY SHUT-OFF VALVE

---

Please observe DVGW guidelines G495 and G499. Further information is available in the operating and maintenance instructions and spare parts list for RMG 790.20. When installing devices with a position indicator in a horizontal position, please ensure that the position indicator is not pointing downwards. The control connections must be easily accessible and fitted with a shut-off valve to enable operational tests to be performed.

## RMG 790 WATER SAFETY SHUT-OFF VALVE

Device designation

### Example

RMG 790a - 50 - 300 - F1 / F / E1 / S - So

		Type	Nominal width	Pressure rating	Control unit with spring	Electrical remote indication of valve position „OFF“	Electromagnetic release triggered by power supplied	Screw bolts	Special model
<b>NOMINAL WIDTH</b>									
DN 25	25								
DN 50	50								
DN 80	80								
DN 100	100								
DN 150	150								
<b>PRESSURE RATING</b>									
PN 10	10								
PN 16	16								
PN25	25								
PN40	40								
Class 300	300								
Class 600	600								
Class 900	900								
Class 1500 (160 bar)	1500								
<b>CONTROL UNIT</b>									
Spring	Setting range $W_g$ in bar								
F 1	2.0...2.5	F 1							
F 2	2.5...3.5	F 2							
F 3	3.5...16.0	F 3							
<b>REMOTE INDICATION</b>									
Electrical remote indication of valve position „OFF“		F							
<b>ELECTROMAGNETIC RELEASE</b>									
Triggered by power supplied					E 1				
Triggered by power failure					E 2				
<b>SCREW BOLTS</b>									
with screw bolts							S		
<b>SPECIAL DESIGN (TO BE EXPLAINED IN DETAIL)</b>									
Special model									So

We reserve the right to make technical changes.

